


PLAN VIEW

GENERAL NOTES:

1. ALL CONCRETE SHALL HAVE A MIX DESIGN OF 5000 PSI WITH A MINIMUM OF 5 SACKS OF STANDARD TYPE 1 CEMENT.
2. ALL REINFORCING BARS SHALL BE CLEAN, NEW AND FREE OF DIRT, RUST, OR OIL AND SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A-615M, GRADE 60.
3. WELDED WIRE FABRIC SHALL BE CLEAN, NEW AND FREE OF DIRT, RUST, OR OIL AND SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A-185.
4. LAP REBARS AT ALL SPLICES A MINIMUM OF 36 BAR DIAMETERS.
5. ALL REINFORCING SHALL BE SET AND TIED, ALL CONCRETE SHALL BE PLACED, FINISHED, AND CURED PER ACI 318-83 SPECIFICATIONS AND PER ALL SAFETY PROVISIONS OF OSHA.
6. MANUFACTURER RESERVES THE RIGHT TO MAKE CHANGES WHENEVER NECESSARY.

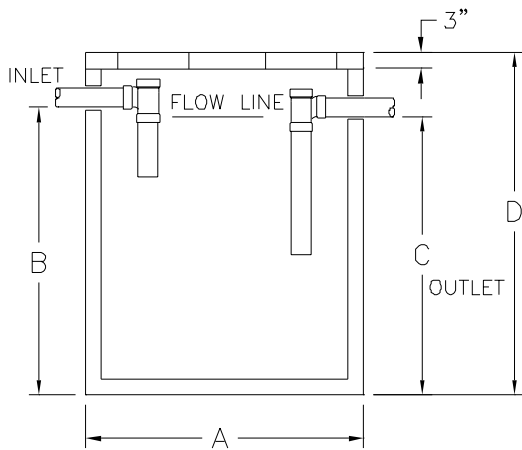

SEPTIC TANKS/ INTERCEPTORS

SEPTIC TANK/ INTERCEPTORS DIMENSIONS
INCHES

SIZE OF SEPTIC TANK	A	B	C	D
200 GALLONS	39"	40"	37"	50"
300 GALLONS	52"	40"	37"	50"
500 GALLONS	57"	61"	58"	71"

PHONE: (800) 852-7880
FAX: (979) 478-6753

P.O. BOX 789
WALLIS, TEXAS 77485

WALLIS CONCRETE, INC.